
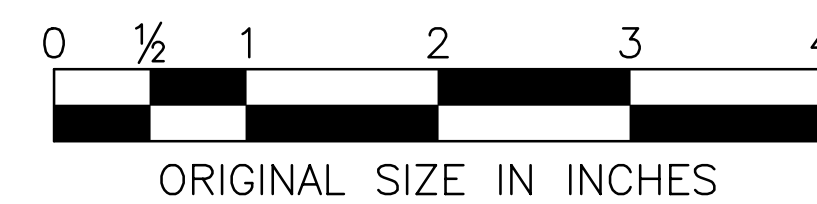
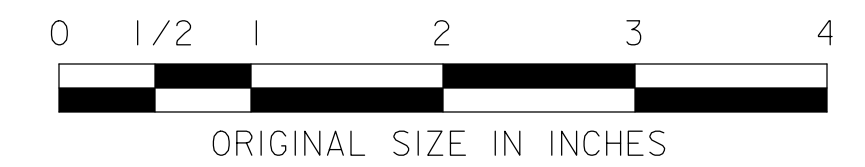


**NOTES:**

1. UNLESS OTHERWISE NOTED ON THIS DRAWING, CONDUIT SHALL BE OF THE SIZE AND TYPE AS SPECIFIED ON THE CONTRACT PLANS.
2. SEE STANDARD DRAWING E-13 FOR JUNCTION BOX TYPE C DETAILS (GROUND ROD REQUIRED BUT NOT SHOWN).
3. ADDITIONAL CONDUITS, PIPING, AND HANGERS SHALL BE COORDINATED WITH THE CONTRACT PLANS FOR OTHER UTILITIES SUCH AS GAS, WATER, AND COMMUNICATIONS.
4. CONDUIT(S) SHALL BE SLOPED TOWARDS JUNCTION BOXES OR MANHOLES, TO MAINTAIN POSITIVE DRAINAGE, AND SIZED AS SHOWN ON THE CONTRACT PLANS.
5. THE MAXIMUM BEND RADIUS OF CONDUITS SHALL BE FOR THE SPECIFIED SIZE AND TYPE AS SHOWN ON THE CONTRACT PLANS.
6. GUIDERAIL AND GUIDERAIL CONNECTION TO BARRIER PARAPET NOT SHOWN FOR CLARITY. COORDINATE INSTALLATION OF GUIDERAIL AS SHOWN ON THE CONTRACT PLANS AND IN ACCORDANCE WITH THE GUIDE RAIL STANDARD DRAWINGS.

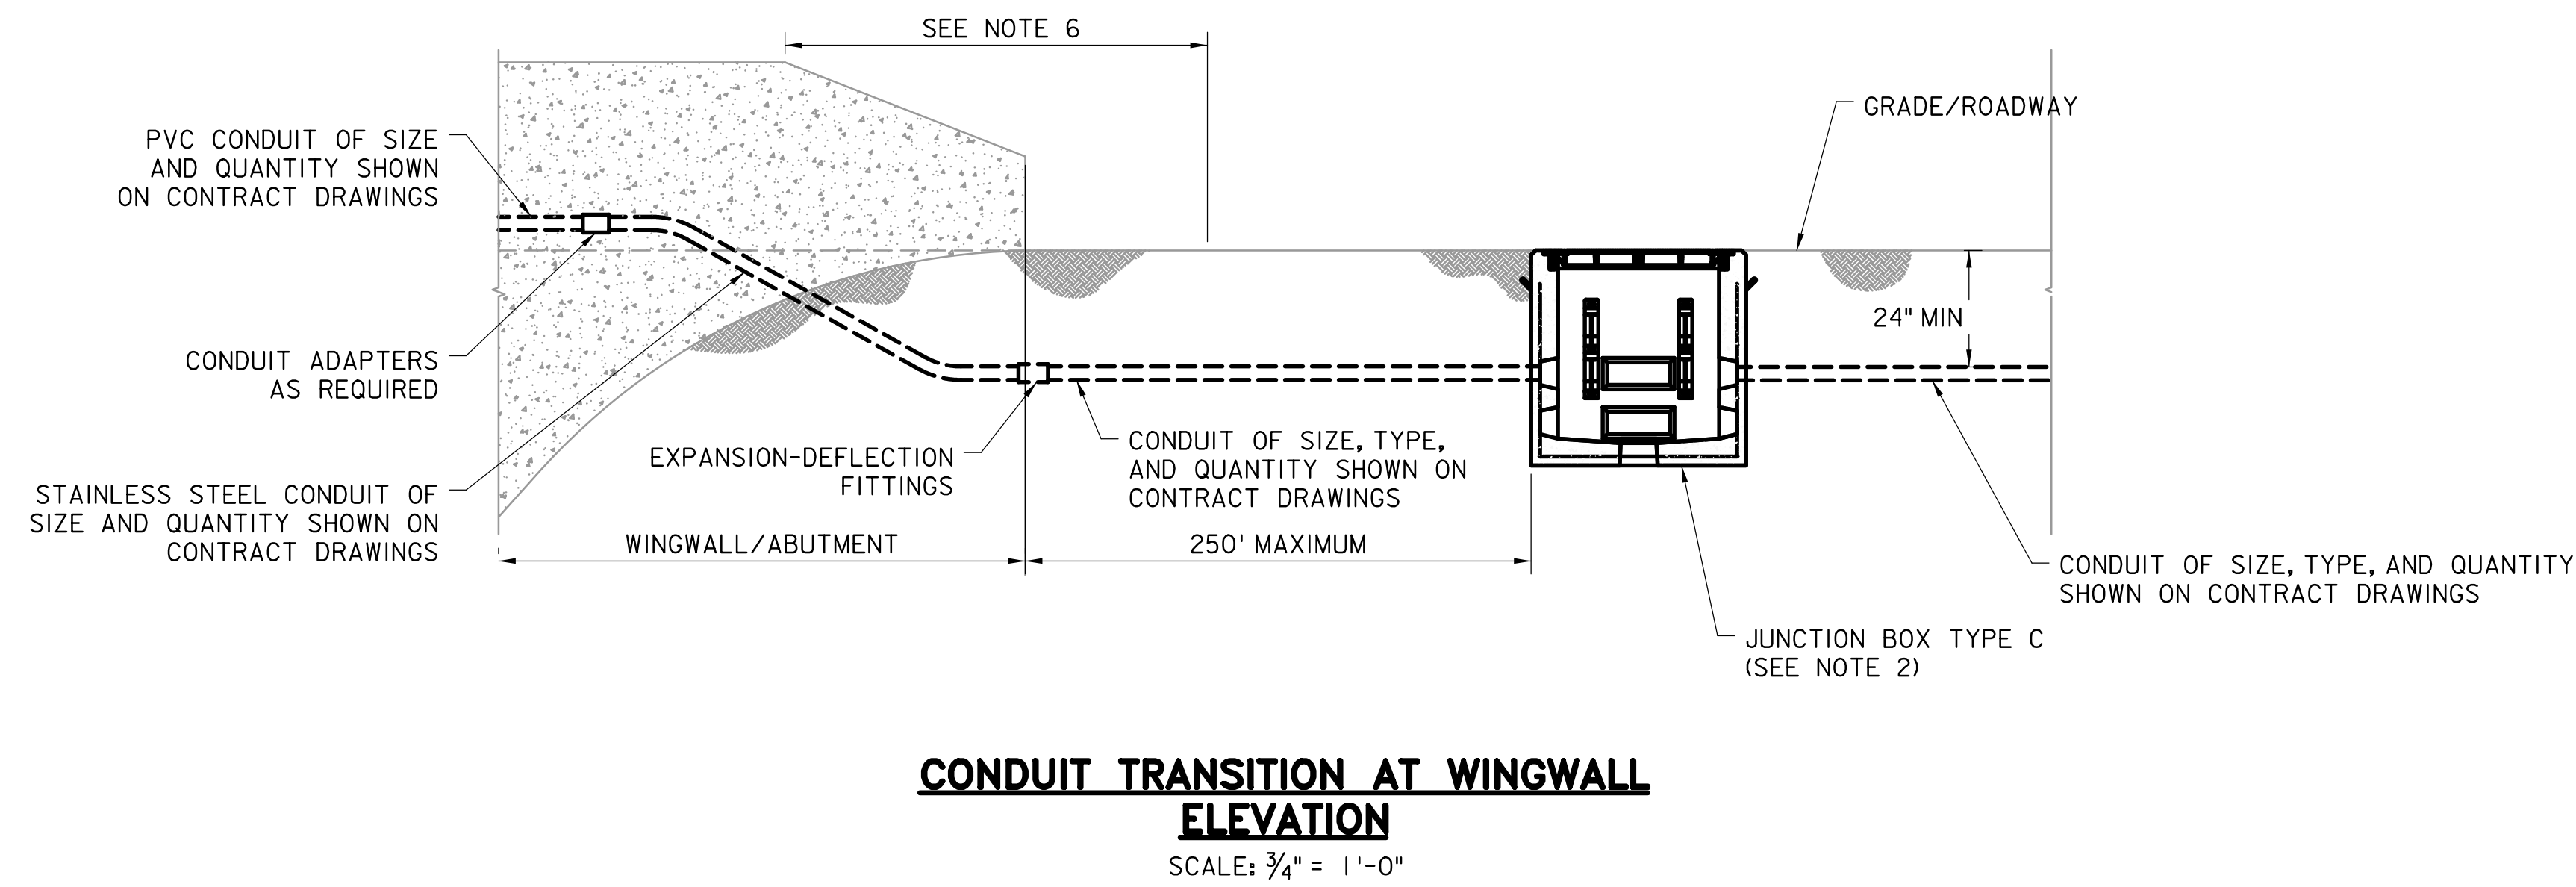

REV.	DESCRIPTION	DATE
0	REISSUED DRAWING	09/21

NEW JERSEY TURNPIKE AUTHORITY  
**NEW JERSEY TURNPIKE  
 GARDEN STATE PARKWAY**  
 STANDARD DRAWINGS

---

**BRIDGE/WALL CONDUIT TRANSITION**

---

OFFICE OF THE CHIEF ENGINEER  
 NEW JERSEY TURNPIKE AUTHORITY  
 WOODBRIDGE, NEW JERSEY

STANDARD DRAWING  
**E-24**